

| Datasheet | | | | |
|-----------|--------|------------|-------|------|
| Mod. | Dwg n. | Date | Check | Rev. |
| P12GD | 941290 | 19/10/2016 | AC | 0 |

FIRE EXTINGUISHER 12KG POWDER

stored pressure type
 Certified PED 2014/68/EU and EN 3.7
 Fire rating 55A – 233B – C




Organic solid materials
wood, rubber, textiles, etc.



Flammable liquids,
gasoline, oil, etc.



Flammable gases,
methane, propane.

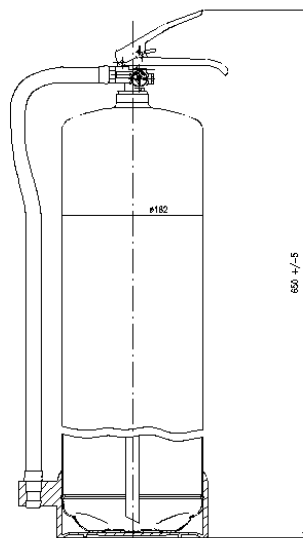

Technical specification

Cylinder diameter _____ : 182 mm
 Material _____ : Steel cylinder, brass valve
 Operating pressure _____ : 15 bar at 20°C
 Test pressure _____ : 30 bar
 Burst pressure _____ : > 55 bar
 Temperature range _____ : -30°C + 60°C
 Extinguishing agent _____ : ABC powder
 Propellant _____ : N₂ + He
 Nominal charge _____ : 12 kg
 Jet length _____ : ~ 7 m


Dimensions

Height: 650 mm
 Diameter: 182 mm
 Weight: 17,5 kg

SPARE PARTS LIST

| Pos. | Description | Code |
|------|------------------|---------|
| 1 | Complete valve | 7203040 |
| 1A | Gauge | 2120001 |
| 1B | Seal | 2250008 |
| 1C | Fixed pin | 2100010 |
| 1D | Safety pin | 2100601 |
| 1E | Check valve | 2170001 |
| 1F | Plug check valve | 2220200 |
| 1G | O-Ring Ø26x3 | 2090203 |
| 1H | Piston group | 2380015 |
| 1I | Spring | 2151200 |
| 1L | Tube holder | 2160500 |
| 2 | Dip tube | 2230126 |
| 3 | Cylinder | 0010735 |
| 4 | ABC powder | 2020003 |
| 5 | Complete hose | 2330077 |
| 6 | Label | - |
| 7 | Bracket | 2200064 |

| Pos. | Description | Code |
|------|--------------|---------|
| 8 | Base (black) | 2017451 |

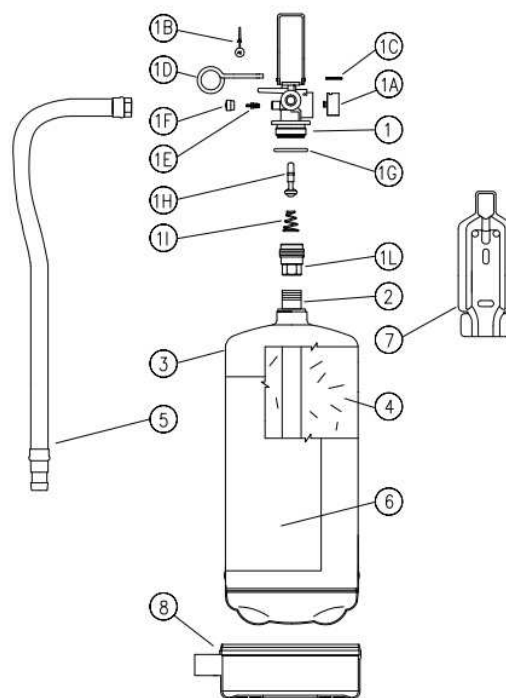

The use of non original spare parts may cause malfunctions loss

Maintenance and Guarantee

Maintenance must be made periodically by, trained and certified staff, according to the local regulations of the country where it is located. The extinguisher is guaranteed for 24 months from the date of the supply. The guarantee includes, repairing or replacement for production defects, unit must be sent back to the factory free of charge, only when authorized written agreement with our sales office has been reached. The guarantee expires in case of tampering and bad maintenance made by not-authorized staff. It must be recharged only by staff authorized and certified by use only original extinguisher agent and spare parts.

Technical data are subject to modification for improvements without prior notice